

# Recommended spare part sets KAF®-S

## For commissioning / continuous operation & strategical spares

- Please note this is only a general recommendation, which may have project related changes.
- Please ask for your detailed spare part quotation for your self-cleaning filter.
- After your definitions of spare packages, Krone will check if technical developments apply and always quote newest technical development.

- 2– 4 weeks
- 4– 8 weeks
- 10–16 weeks for special materials or versions

\* Lead time depends on version, model and materials. Exact delivery time will be mentioned in quotation by Krone Filter Solutions.

\*\* Dependent on filter operational stress/flush frequency depending on water quality.

\*\*\* If purchased together with 2–3 year operational spares the SET 2, 4 and 5 can be reduced to 1 pcs.

\*\*\*\* Recommended number of strategical spare packages 30% of filter's in operation/min. 1 package. If purchased with 4–7\*\* years operational spares package can be reduced by those positions.


Commissioning spares		
SET	Recommended quantity per filter	Lead time rating*
2	1	●
4	1	●
5	1	●

2–3 years operation spares		
SET	Recommended quantity per filter	Lead time rating*
2	2	●
3	1	● ●
4	2	●
5	2	●
7	1	●
10	1	●
12	1	● ●

4–7** years operational spares		
SET	Recommended quantity per filter***	Lead time rating*
1	1	● ●
2	2	●
3	1	● ●
4	3	●
5	3	●
6	1	● ●
7	1	●
8	1	●
10	1	●
11	1	● ●
12	1	● ●
13	1	● ●

Strategical spare package recommended purchase latest 1 year after START-UP****		
SET	Recommended quantity per filter	Lead time rating*
1	1	● ●
2	1	●
3	1	● ●
4	1	●
5	1	●
6	1	● ●
7	1	●
8	1	●
9	1	●
10	1	●
11	1	● ●
12	1	● ●
13	1	● ●
14	1	● ●
15	1	● ●

# KAF<sup>®</sup>-S spare part sets

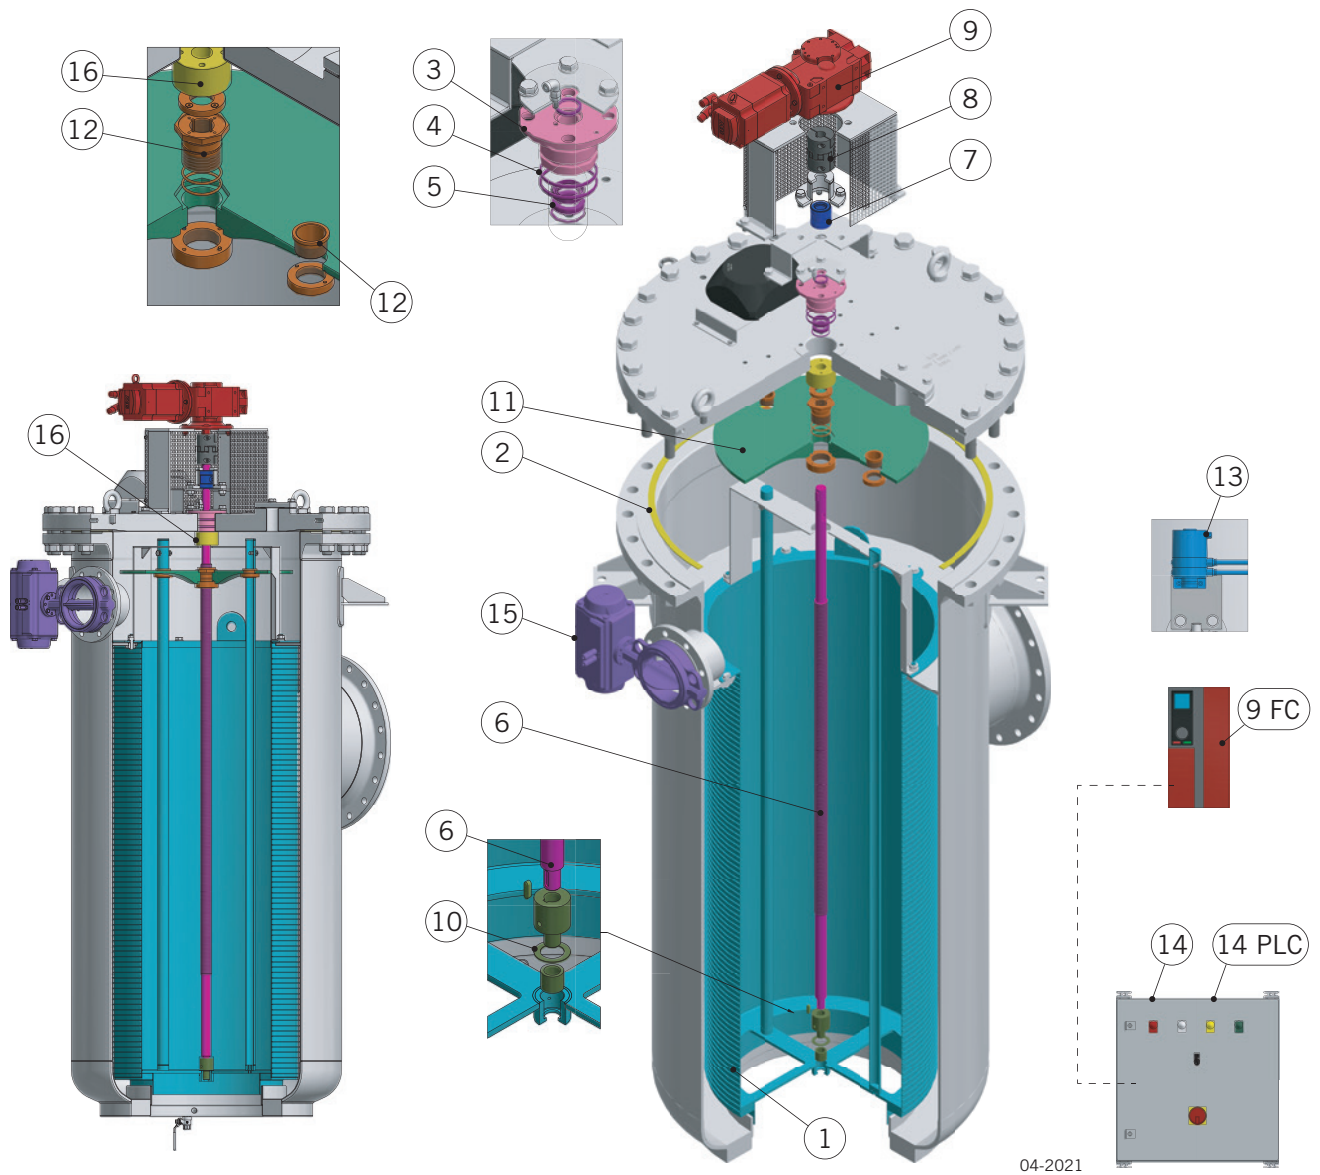

## KAF<sup>®</sup>-S spare part sets

Set	Content
1	Insert, sealing (optional), set of bolts (without spindle set 6 & 10)
2	Cover gasket
3	Cover bushing
4	Sealing & snap ring for cover bushing
5	Sealing for spindle
6	Spindle
7	Bearing unit for spindle
8	Coupling
9	Motor with gear box

Set	Content
9 FC	Frequency Converter (mounted in 14)
10	Bearing unit insert
11	Flushing disc
12	Flushing disc bushings
13	Differential pressure switch or transmitter
14	Control unit complete LCP cabinet with 9 FC & 14 PLC
14 PLC	Only CPU controller
15	Flushing valve
16	Special spindle bearing (optional)